

POWER

- DISTRIBUTION PANELBOARD
- NEW PANELBOARD - SURFACE
- NEW PANELBOARD - RECESSED
- EXISTING PANELBOARD
- GENERATOR
- TRANSIENT VOLTAGE SURGE SUPPRESSOR
- TRANSFORMER
- POWER SUPPLY
- CONTROL PANEL
- TIME CLOCK
- ASTRONOMICAL TIME CLOCK - "SEE SPEC."
- RELAY WITH RATING AND NUMBER OF POLES AS NOTED ON DRAWINGS - "SEE SPEC."
- JUNCTION BOX
- JUNCTION BOX - CEILING
- PULL BOX
- BUS DUCT HORIZONTAL
- BUS DUCT VERTICAL
- EMERGENCY POWER OFF PUSH BUTTON
- NON-FUSIBLE SAFETY SWITCH
- FUSIBLE SAFETY SWITCH
- ENCLOSED CIRCUIT BREAKER
- MOTOR STARTER - FURNISHED BY MECHANICAL CONTRACTOR. ELECTRICAL CONTRACTOR SHALL INSTALL AND PROVIDE POWER CONNECTION
- COMBINATION STARTER/DISCONNECT - FURNISHED BY MECHANICAL CONTRACTOR. ELECTRICAL CONTRACTOR SHALL INSTALL AND PROVIDE POWER CONNECTION
- VARIABLE FREQUENCY DRIVE - FURNISHED BY MECHANICAL CONTRACTOR. ELECTRICAL CONTRACTOR SHALL INSTALL AND PROVIDE POWER CONNECTION
- MOTOR
- MOTOR STARTING SWITCH
- KEY SWITCH
- FAN COIL - FURNISHED BY MECHANICAL CONTRACTOR. ELECTRICAL CONTRACTOR SHALL INSTALL AND PROVIDE POWER CONNECTION
- UNIT HEATER - FURNISHED BY MECHANICAL CONTRACTOR. ELECTRICAL CONTRACTOR SHALL INSTALL AND PROVIDE POWER CONNECTION
- CABINET HEATER - FURNISHED BY MECHANICAL CONTRACTOR. ELECTRICAL CONTRACTOR SHALL INSTALL AND PROVIDE POWER CONNECTION
- UNIT VENTILATOR - FURNISHED BY MECHANICAL CONTRACTOR. ELECTRICAL CONTRACTOR SHALL INSTALL AND PROVIDE POWER CONNECTION
- ELECTRIC BASEBOARD - FURNISHED BY MECHANICAL CONTRACTOR. ELECTRICAL CONTRACTOR SHALL INSTALL AND PROVIDE POWER CONNECTION
- HAND DRYER - FURNISHED BY MECHANICAL CONTRACTOR. ELECTRICAL CONTRACTOR SHALL INSTALL AND PROVIDE POWER CONNECTION
- JUNCTION BOX FOR RANGE HOOD
- JUNCTION BOX FOR CONNECTION TO GARBAGE DISPOSAL
- LIGHT/HEATER/FAN - FURNISHED BY MECHANICAL CONTRACTOR. ELECTRICAL CONTRACTOR SHALL INSTALL AND PROVIDE POWER CONNECTION
- PROJECTION SCREEN WIRING CONNECTION
- REMOTE SWITCH TO CONTROL PROJECTION SCREEN

MEDICAL SYSTEMS

- ISOLATION PANELBOARD
- X-RAY VIEW BOX - "SEE SPEC."
- COMBINATION POWER AND GROUND POINT OUTLET BOX - "SEE SPEC." "X" = NUMBER OF DEVICES / GND POINTS
- LINE ISOLATION MONITOR
- MEDICAL GAS ALARM PANEL
- PHYSIOLOGICAL MONITOR OUTLET

RECEPTACLES

- SINGLE 125V-20A RECEPTACLE
- DUPLEX 125V-20A RECEPTACLE
- 250V 2-POLE, 3-WIRE RECEPTACLE (X) INDICATES AMPERE
- DUPLEX RECEPTACLE BOTTOM HALF SWITCHED - SEE PLANS FOR SWITCH LOCATION
- DUPLEX RECEPTACLE GROUND FAULT INTERRUPTER TYPE
- DUPLEX RECEPTACLE ON DEDICATED CIRCUIT FOR COMPUTER LOADS
- DUPLEX RECEPTACLE GROUND FAULT INTERRUPTER TYPE. INSTALL IN WEATHERPROOF HOUSING
- DOUBLE DUPLEX RECEPTACLE
- ISOLATED GROUND DUPLEX RECEPTACLE
- DUPLEX RECEPTACLE FOR MICROWAVE. MT. AS DIRECTED BY ARCHITECT
- DUPLEX RECEPTACLE EXPLOSION PROOF TYPE
- ELECTRIC WATER COOLER - GROUND FAULT INTERRUPTER TYPE RECEPTACLE
- SPECIAL RECEPTACLE - COORDINATE EXACT TYPE WITH EQUIPMENT AT SITE
- 125/250V - 2 POLE, 3 WIRE 30A SINGLE RECEPTACLE
- 125/250V - 3 POLE, 3 WIRE 30A SINGLE RECEPTACLE
- 125/250V - 3 POLE, 3 WIRE 50A SINGLE RECEPTACLE
- 125/250V - 3 POLE, 4 WIRE 50A SINGLE RECEPTACLE
- FIRE RATED POKE-THRU RECEPTACLE
- FLUSH FLOOR BOX WITH DUPLEX RECEPTACLE & TELE/DATA OUTLET AND COVER PLATE
- PLUG STRIP INDICATES MOUNT DEVICE ABOVE COUNTER TOP

LIGHTING PROTECTION

- AIR TERMINAL 1/2" O.D. X 12' SOLID COPPER, NICKEL PLATED ON ADHESIVE BASE.
- EQUIPMENT AIR TERMINAL
- TEST WELL WITH GROUND ROD(S)
- GROUND ROD
- GROUND PLATE
- MAIN GROUND CONDUCTOR CONCEALED WITHIN CONSTRUCTION
- MAIN GROUND CONDUCTOR EXPOSED ON EXPOSED SURFACE
- GROUND CONDUCTOR CAD WELDED TO GROUND CABLE OR EQUIPMENT
- GROUND CONDUCTOR CAD WELDED TO BUILDING STEEL COLUMN
- GROUND ROD TRIPOD, SPACED 10 FEET APART.
- LEVEL TO LEVEL CABLE

NURSE CALL

- NURSE CALL SYSTEM EQUIPMENT CABINET
- NURSE CALL SYSTEM CONSOLE
- NURSE CALL SYSTEM ANNUNCIATOR
- NURSE CALL DOME - W/ONE LAMP "Z" = ZONE
- NURSE CALL DOME - W/TWO LAMPS
- NURSE CALL DOME - W/THREE LAMPS
- NURSE CALL PATIENT STATION - BEDSIDE W/TWO CALL CORDS
- NURSE CALL PATIENT STATION - BEDSIDE
- NURSE CALL EMERGENCY PULL CORD "WT" = WATER TIGHT
- NURSE CALL - CODE BLUE
- NURSE CALL - DUTY STATION
- NURSE CALL - STAFF STATION
- NURSE CALL - PUSH FOR HELP
- NURSE CALL - BED INTERFACE

LIGHTING

- LIGHTING FIXTURE - SEE FIXTURE SCHEDULE FOR MORE INFORMATION
- NORMAL/EMERGENCY LIGHTING FIXTURE - SEE FIXTURE SCHEDULE FOR MORE INFORMATION
- DOWNLIGHT
- LIGHTING FIXTURE ON NORMAL/EMERGENCY
- LIGHTING FIXTURE ON EMERGENCY ONLY
- WALL WASHER
- WALL MOUNTED LIGHT FIXTURE
- CHANDELIER
- INTERIOR DIRECTIONAL LIGHTING FIXTURE
- TRACK LIGHTING
- LIGHT FIXTURE WITH CENTER LAMP ON NORMAL/EMERGENCY CIRCUIT & OUTSIDE LAMP(S) ON NORMAL CIRCUIT
- EXIT SIGN - DIRECTIONAL ARROWS AS INDICATED ON DRAWINGS
- BATTERY PACK WITH HEADS AS INDICATED ON DRAWINGS
- REMOTE HEAD FOR BATTERY PACK
- SINGLE POLE SWITCH
- 3-WAY SWITCH
- 4-WAY SWITCH
- KEY SWITCH
- PILOT LIGHT SWITCH
- HAND-OFF AUTO SWITCH
- SINGLE POLE, DOUBLE THROW, CENTER OFF TOGGLE SWITCH
- EMERGENCY POWER OFF SWITCH
- DIMMER SWITCH
- CEILING MOUNTED OCCUPANCY SENSOR
- WALL MOUNTED OCCUPANCY SENSOR
- PHOTOCELL VOLTAGE TO MATCH CIRCUITRY
- LIGHTING CONTROLLER
- BOLLARD
- POLE MOUNTED SITE LIGHTING FIXTURE - NUMBER OF FIXTURES PER POLE AS INDICATED ON DRAWINGS
- POLE TOP MOUNTED SITE LIGHTING FIXTURE
- EXTERIOR DIRECTIONAL LIGHTING FIXTURE
- SMALL CASE LETTERS REPRESENTS LAMP(S) / SWITCHES. WHEN USED WITH AN OCCUPANCY SENSOR THIS INDICATES SENSOR WITH MANUAL OVERRIDE SWITCH
- 2-POLE WALL OCCUPANCY SWITCH
- SINGLE POLE WALL OCCUPANCY SWITCH

TELECOMMUNICATIONS

- TELEPHONE OUTLET(S) @ 18" AFF. U.N.O. WITH 3/4" RACEWAY TERMINATED ABOVE NEAREST ACCESSIBLE CEILING OR TO TELEPHONE TERMINAL BOARD IF NO ACCESSIBLE CEILING AVAILABLE. SEE TELE/DATA RISER DIAGRAM FOR OUTLET AND CABLE DESCRIPTION
- DATA OUTLET(S) @ 18" AFF. U.N.O. WITH 3/4" RACEWAY TERMINATED ABOVE NEAREST ACCESSIBLE CEILING OR TO DATA EQUIPMENT RACK IF NO ACCESSIBLE CEILING AVAILABLE. SEE TELE/DATA RISER DIAGRAM FOR OUTLET AND CABLE DESCRIPTION
- COMBINATION TELEPHONE/DATA OUTLET(S) @ 18" AFF. U.N.O. WITH 1" RACEWAY TERMINATED ABOVE NEAREST ACCESSIBLE CEILING OR TO TELE/DATA TERMINAL BOARD IF NO ACCESSIBLE CEILING AVAILABLE. SEE TELE/DATA RISER DIAGRAM FOR OUTLET AND CABLE DESCRIPTION
- WALL MTD. TELEPHONE OUTLET WITH 3/4" RACEWAY TERMINATED ABOVE NEAREST ACCESSIBLE CEILING OR TO TELEPHONE TERMINAL BOARD IF NO ACCESSIBLE CEILING AVAILABLE. SEE TELE/DATA RISER DIAGRAM FOR OUTLET AND CABLE DESCRIPTION
- FLOOR BOX WITH TELEPHONE OUTLET AND 3/4" RACEWAY TO TELEPHONE TERMINAL BOARD. SEE TELE/DATA RISER DIAGRAM FOR OUTLET AND CABLE DESCRIPTION
- FLOOR BOX WITH DATA OUTLET AND 3/4" RACEWAY TO DATA EQUIPMENT RACK. SEE TELE/DATA RISER DIAGRAM FOR OUTLET AND CABLE DESCRIPTION
- FLOOR BOX WITH TELEPHONE AND DATA OUTLETS AND 3/4" RACEWAY TO TELE/DATA TERMINATION AREA. SEE TELE/DATA RISER DIAGRAM FOR OUTLET AND CABLE DESCRIPTION
- INDICATES NUMBER OF TELEPHONE OUTLET(S) AND ASSOCIATED CABLING
- INDICATES NUMBER OF DATA OUTLET(S) AND ASSOCIATED CABLING
- INDICATES NUMBER OF TELEPHONE OUTLETS AND ASSOCIATED CABLING WITH 1 OUTLET AND CABLE DEDICATED FOR FAX
- DATA OUTLET FOR WIRELESS ACCESS POINT
- FIRE RATED POKE-THRU WITH TELE/DATA OUTLET
- MAIN DISTRIBUTION FRAME EQUIPMENT RACK
- INTERMEDIATE DISTRIBUTION FRAME EQUIPMENT RACK
- COPPER CONDUCTOR PROTECTION MODULE PANEL ONE MODULE PER CONDUCTOR
- WALL MOUNTED DISTRIBUTION EQUIPMENT MOUNTED ON FIRE RESISTANT 3/4" PLWOOD BACKBOARD
- TELEPHONE TERMINAL BOARD
- CATV TERMINAL BOARD

SINGLE LINE SYMBOLS

- SWITCH
- BREAKER
- FUSE
- TRANSFORMER
- CAPACITOR
- GROUND
- CONTACT (NORMALLY OPEN)
- CONTACT (NORMALLY CLOSED)
- BATTERY
- AUTOMATIC TRANSFER SWITCH
- MANUAL DOUBLE THROW SWITCH
- CURRENT TRANSFORMER
- POTENTIAL TRANSFORMER
- INDICATES NEW ELECTRICAL EQUIPMENT
- INDICATES ELECTRICAL EQUIPMENT TO REMAIN
- INDICATES EXISTING EQUIPMENT TO BE REMOVED
- INDICATES NEW CONTROL WIRING AND CONDUIT
- EQUIPMENT OUTLINE

SINGLE LINE NOTE:
THE EC SHALL REMOVE THE OLD EQUIPMENT AS NOTED WHEN THE NEW EQUIPMENT IS INSTALLED AND READY FOR SERVICE

SECURITY & DOOR CONTROL

- SECURITY SYSTEM CONTROL PANEL
- AUTOMATED DIALER COMMUNICATOR
- SECURITY CAMERA
- SECURITY CAMERA IN BUBBLE
- SECURITY MONITOR
- MOTION SENSOR
- GLASS BREAK
- SOUND SENSOR
- DOOR/SECURITY ANNUNCIATOR
- QUAD PID MODULE
- CARD READER
- KEYPAD
- PUSH-BUTTON
- DOOR OPEN PUSH-BUTTON
- AUTOMATIC DOOR PUSH-BUTTON STATION
- REQUEST FOR EXIT
- DOOR CONTACT
- ELECTRIC STRIKE
- ELECTROMAGNETIC DOOR LOCK
- ELECTROMAGNETIC DOOR HOLDER

AUDIO/VISUAL

- PA SYSTEM EQUIPMENT RACK
- LOCAL SOUND SYSTEM EQUIPMENT RACK
- AUDIO/VISUAL SYSTEM EQUIPMENT RACK
- INTERCOM MASTER STATION
- INTERCOM SLAVE STATION
- VOLUME CONTROL
- MICROPHONE JACK
- PA SYSTEM HANDSET
- SOUND SYSTEM SPEAKER CEILING MOUNTED
- LOCAL SPEAKER - CEILING MOUNTED
- SOUND SYSTEM SPEAKER WALL MOUNTED
- LOCAL SPEAKER - WALL MOUNTED
- SPEAKER - HORN
- CLOCK/SPEAKER
- CLOCK - END MOUNTED DOUBLE FACED. "X" DENOTES FACE SIZE IN INCHES
- CLOCK - WALL MOUNTED. "X" DENOTES FACE SIZE IN INCHES
- TELEVISION OUTLET
- CONTROL MODULE
- EQUIPMENT RACK
- SOUND SYSTEM WIRING AND RACEWAY
- TEACHERS STATION PROJECTOR OUTLET. OUTLET SHALL CONTAIN CONNECTION AND RACEWAY TO CEILING MOUNTED PROJECTOR AND SHALL BE LOCATED NEXT TO THE MULTIMEDIA OUTLET
- CEILING MOUNTED PROJECTOR OUTLET. OUTLET SHALL CONTAIN CONNECTION AND RACEWAY TO CEILING MOUNTED PROJECTOR OUTLET
- CAMERA OUTLET. OUTLET SHALL CONTAIN CONNECTION AND RACEWAY TO MULTIMEDIA OUTLET
- MULTIMEDIA OUTLET. OUTLET SHALL CONTAIN CONNECTIONS AND RACEWAYS TO CAMERA, MICROPHONE, CATV, AND SPEAKERS AND SHALL BE LOCATED NEXT TO MEDIA CABINET OR SMART PODIUM
- SMART CLASSROOM SPEAKER OUTLETS. OUTLET SHALL CONTAIN CONNECTION AND RACEWAY TO MULTIMEDIA OUTLET

MISCELLANEOUS

- BRANCH CIRCUIT WIRING CONCEALED IN WALLS OR ABOVE CEILING
- BRANCH CIRCUIT WIRING - #10 AWG
- BRANCH CIRCUIT WIRING - UNDER FLOOR
- HOME RUN BACK TO PANEL
- CONDUIT EXPOSED ON WALLS OR CEILING
- EXISTING CONDUIT TO REMAIN - REMOVE EXISTING CONDUCTORS & INSTALL NEW CONDUCTORS AS INDICATED
- CONDUIT TURNED DOWN
- CONDUIT TURNED UP
- LOW VOLTAGE WIRING AND CONDUIT
- HORIZONTAL RUN OF SURFACE METAL / NON-METALLIC RACEWAY
- VERTICAL RUN OF SURFACE RACEWAY
- CABLE TRAY ("X" DENOTES WIDTH)
- INDICATES CONTINUATION OF LINE
- HORIZONTAL CONDUIT SLEEVE

FIRE ALARM

- FIRE ALARM CONTROL PANEL
- FIRE ALARM CONTROL PANEL WITH BATTERY BACKUP
- FIRE ALARM ANNUNCIATOR PANEL
- FIRE ALARM TRANSPOUNDER CABINET (SIGNAL EXTENDER)
- FIRE ALARM TRANSPOUNDER CABINET (SIGNAL EXTENDER) WITH BATTERY BACKUP
- AUTOMATED DIALER COMMUNICATOR
- ZONE ADDRESSABLE MODULE
- CONTROL MODULE RELAY
- FIRE ALARM POWER SUPPLY
- ANSUL SYSTEM HOOK UP, FURNISHED BY KITCHEN EQUIPMENT CONTRACTOR. THE ELECTRICAL CONTRACTOR SHALL INSTALL AND WIRE HOOK UP FOR BOTH POWER AND FIRE ALARM CONNECTIONS AS REQUIRED.
- AREA OF RESCUE SYSTEM - MASTER STATION
- AREA OF RESCUE SYSTEM - SIGNAGE
- AREA OF RESCUE SYSTEM - SLAVE STATION
- FIRE ALARM PULL STATION
- FIRE ALARM STROBE - WALL MOUNTED
- FIRE ALARM AUDIBLE/STROBE - WM
- FIRE ALARM HORN/STROBE - WM
- FIRE ALARM SPEAKER/STROBE - WM
- FIRE ALARM AUDIBLE - CEILING MOUNTED
- FIRE ALARM AUDIBLE AND VISIBLE - CM
- FIRE ALARM SPEAKER AND VISIBLE - CM
- FIRE ALARM STROBE - CM
- SMOKE DETECTOR (DETECTOR SHALL BE PLACED A MINIMUM OF 36" FROM HVAC DIFFUSER)
- SMOKE DETECTOR - APARTMENT CEILING MOUNTED, 120V WITH 9V BATTERY BACK-UP AND TWO (2) PAIRS OF AUXILIARY CONTACTS FOR TANDEM WIRING
- SMOKE DETECTOR - APARTMENT WALL MOUNTED, 120V WITH 9V BATTERY BACK-UP AND TWO (2) PAIRS OF AUXILIARY CONTACTS FOR TANDEM WIRING
- SMOKE DETECTOR - WALL MOUNTED WITH AUDIBLE BASE
- SMOKE DETECTOR - CEILING MOUNTED WITH AUDIBLE BASE
- HEAT DETECTOR CEILING MOUNTED
- DUCT DETECTOR - PROVIDED BY EC. INSTALLED BY MC AND CONNECTED BY EC
- FLOW SWITCH - PROVIDED BY OTHERS, AND CONNECTED BY EC
- TAMPER SWITCH - PROVIDED BY OTHERS, AND CONNECTED BY EC
- FIREMAN'S TELEPHONE JACK
- FIRE ALARM REMOTE INDICATOR LAMP
- END OF LINE DEVICE
- REMOTE INDICATOR / TEST STATION

DENOTATIONS & ABBREVIATIONS

- ADM ADMINISTRATOR
- AFM ABOVE FINISHED FLOOR
- C CEILING MOUNTED
- CATV COMMUNITY ANTENNA TELEVISION
- CCF CLOSED CIRCUIT TELEVISION
- COFF COFFEE MAKER
- CH CHIME
- CO CENTER OFF
- DD DOUBLE DEVICE
- DF DOUBLE FACED DEVICE
- DM EXISTING TO BE DEMOLISHED
- DO DOOR OPEN
- E EMERGENCY
- EC ELECTRICAL CONTRACTOR
- EPC EMERGENCY POWER OFF
- EWC ELECTRIC WATER COOLER
- EXP EXPLOSION PROOF
- F FIRE ALARM
- FF FLUSH FLOOR MOUNTED
- FL FLUORESCENT
- FO FIBER OPTIC
- FSS FUSED SAFETY SWITCH
- G GROUND FAULT INTERRUPTER
- GC GENERAL CONTRACTOR
- HOA HAND-OFF AUTO
- I INFRARED
- ICD INCANDESCENT
- IG ISOLATED GROUND KEY
- K LOW VOLTAGE MOTOR
- MC MECHANICAL CONTRACTOR
- ML MULTI-LINE
- M MICROWAVE
- N NURSE CALL
- NE NORMAL/EMERGENCY
- NFSS NON-FUSED SAFETY SWITCH
- P PANIC ("CODE BLUE") PAGING SYSTEM
- PAY PAY TELEPHONE
- PL PILOT LIGHT
- PLN PLUMBING CONTRACTOR
- PLC PRESENT LOCATION/ REPLACED WITH NEW
- REF REFRIGERATOR
- REL RELOCATE
- RED RELOCATED
- S SOUND SYSTEM
- SEC SECURITY SYSTEM
- SL SINGLE LINE
- SS SURGE SUPPRESSION
- T TELEPHONE
- TL TWIST LOCK
- TP TAMPER PROOF
- U ULTRASONIC
- UE UNDERGROUND ELECTRIC
- UF UNDERGROUND FIBER
- UT UNDERGROUND TELEPHONE
- W WALL MOUNTED
- WG WIRE GUARD
- WP WEATHERPROOF
- WPG WEATHERPROOF/GROUND FAULT INTERRUPTER
- WT WATER TIGHT
- XR EXISTING TO REMAIN

GENERAL PROJECT NOTES:

- UNLESS OTHERWISE NOTED, PROVIDE ALL EQUIPMENT SHOWN ON THE PLANS.
- COORDINATE THE FINAL LOCATIONS OF ALL LIGHT FIXTURES WITH THE ARCHITECT'S REFLECTED CEILING PLANS. REPORT ANY DISCREPANCIES TO THE ARCHITECT PRIOR TO INSTALLATION.
- THE CONTRACTOR SHALL VERIFY THE LOCATION OF ALL UNDERGROUND UTILITIES WITHIN THE CONSTRUCTION AREA THREE (3) WORKING DAYS NOTICE BEFORE COMMENCE DIGGER. NOTIFY THE LOCAL OR STATE AUTHORITY HAVING JURISDICTION AND WAIT THE REQUIRED TIME BEFORE COMMENCING TO DIG.
- IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO NOTIFY THE PROFESSIONAL IF A SYMBOL IS USED ON THE PROJECT BUT DOES NOT SHOW IN THE SYMBOL LIST PRIOR TO BID.
- THE CONTRACTOR SHALL COORDINATE CONDUIT RUNS, CABLE TRAY, LIGHTING FIXTURES AND OTHER EQUIPMENT LOCATIONS WITH THE OTHER TRADE CONTRACTORS TO AVOID CONFLICTS.

CALLISON|RTKL
A DESIGN CONSULTANCY OF ARCADIS

Callison|RTKL, Inc.
2101 L Street, NW, Suite 200
Washington, DC 20037
T: 202.833.4400
F: 202.887.5168
www.callisonrtkl.com

Consultant

QJL ENGINEERING
222 Harner Street
Johnstown, PA 15002
ph(814)688-1661 fax(814)688-8788
cell Project #16-0700

Meritus Health
NORTH END PRACTICE

GHATTAS ENTERPRISES

DRAWING ISSUE LOG

1	2017.02.06	DESIGN DEVELOPMENT
2	2017.02.22	100% DESIGN DEVELOPMENT
3	2017.04.03	PRELIMINARY BID SET
4	2017.04.14	BID SET


NOT FOR CONSTRUCTION

Sheet Identification

SYMBOLS AND NOTES

E001

FILE NAME: I:\1616-0700\16-0700-Rev04\2016-12-20 From RTKL\181 - Centre - 12_19_16 Rev04\CENTRE_Detailed.rvt
12/22/2016 8:07:59 AM

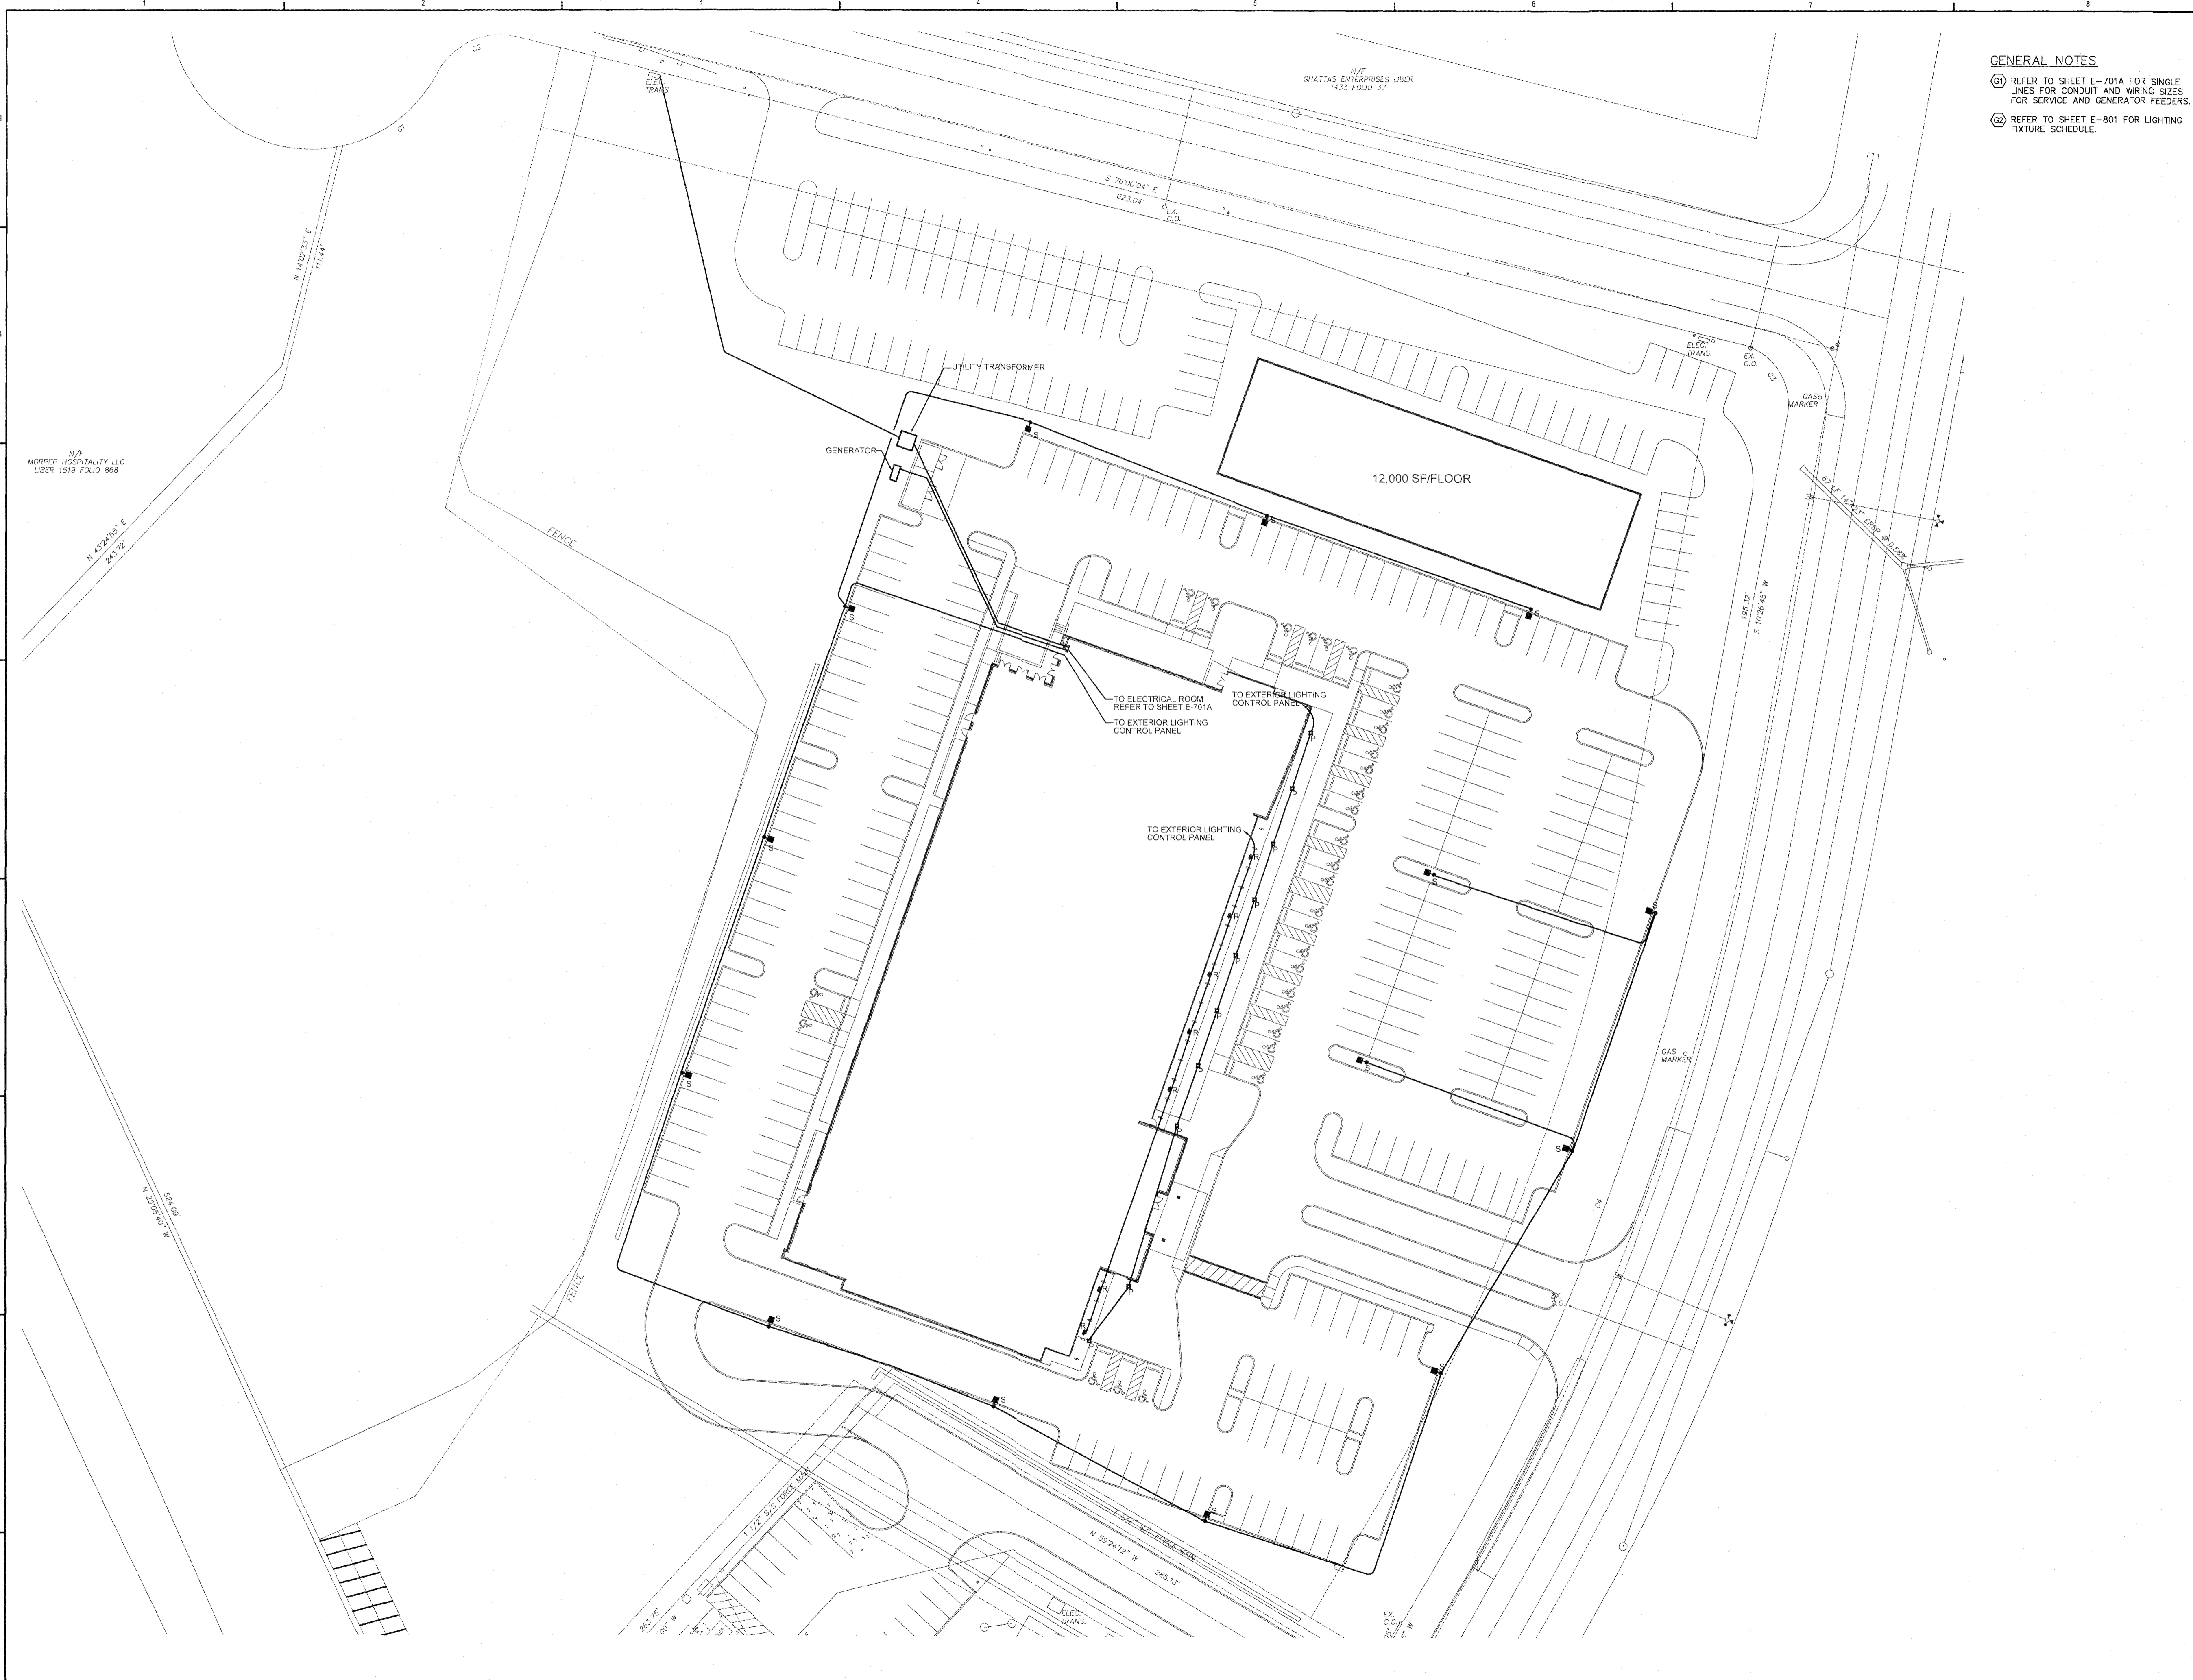

GENERAL NOTES

- ① REFER TO SHEET E-701A FOR SINGLE LINES FOR CONDUIT AND WIRING SIZES FOR SERVICE AND GENERATOR FEEDERS.
- ② REFER TO SHEET E-801 FOR LIGHTING FIXTURE SCHEDULE.

Consultant



232 Harner Street
Johantown, PA 15082
ph:(814)698-1661 fax:(814)698-0788
cell: Project #18-0780



DRAWING ISSUE LOG

NO.	DATE	DESCRIPTION
1	2017.02.08	DESIGN DEVELOPMENT
2	2017.02.22	100% DESIGN DEVELOPMENT
3	2017.04.03	PRELIMINARY BID SET
4	2017.04.14	BID SET

Seal _____

NOT FOR CONSTRUCTION

Sheet Identification _____

SITE PLAN - ELECTRICAL

E002